


COMPANY:	<input type="text"/>	ORDER DATE:	<input type="text"/>
ORDERED BY:	<input type="text"/>	DUE DATE:	<input type="text"/>
PHONE #:	<input type="text"/>	P.O. NO. / JOB:	<input type="text"/>

HORIZONTAL SPLIT SYSTEM

*PROVIDE BUILD-TO MEASUREMENTS ONLY

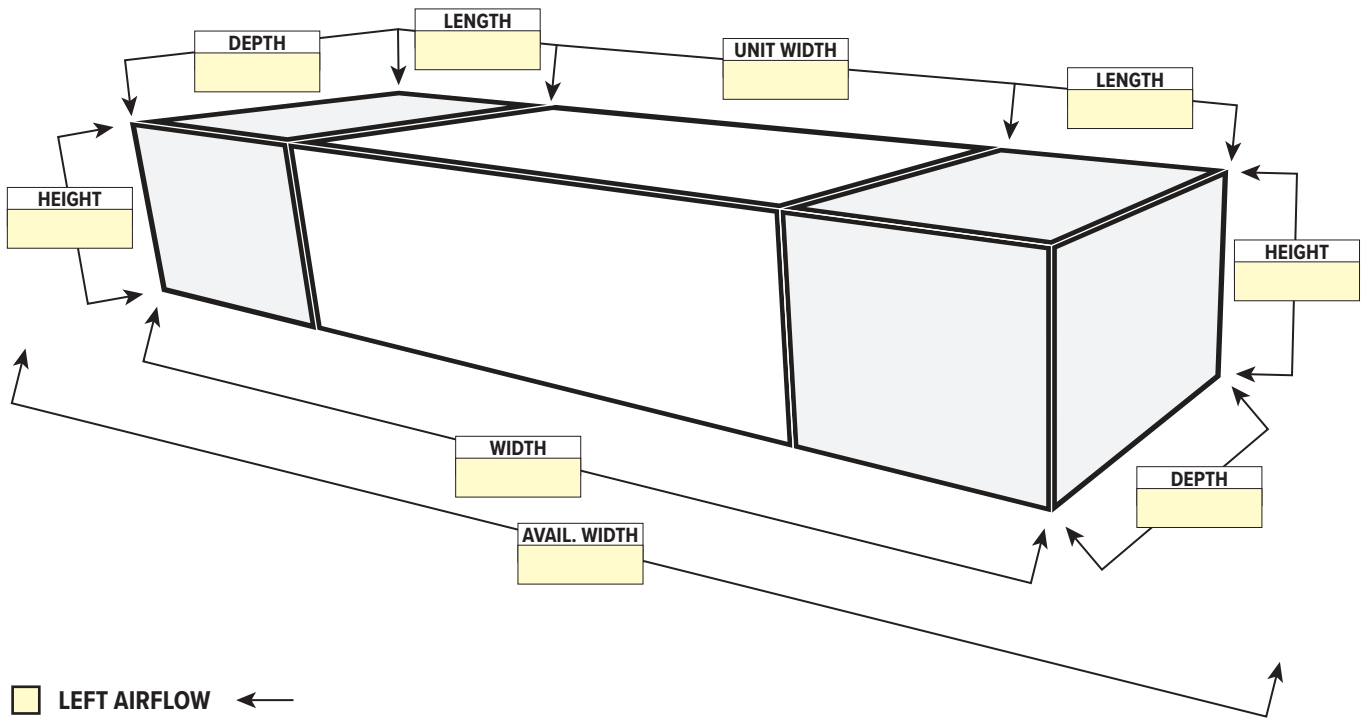

- LEFT AIRFLOW ←
- RIGHT AIRFLOW →

- | | | | |
|---------------------------------------|--|---|------------------------------------|
| <input type="checkbox"/> LINER 1" | <input type="checkbox"/> ASSEMBLED PLENUMS | <input type="checkbox"/> AHU DRAIN PAN | <input type="checkbox"/> DELIVERY |
| <input type="checkbox"/> LINER 1/2" | <input type="checkbox"/> DISASSEMBLED PLENUMS | <input type="checkbox"/> COIL ONLY DRAIN PAN | <input type="checkbox"/> WILL CALL |
| <input type="checkbox"/> BB REFLECTIX | <input type="checkbox"/> BEAD STIFFENED | <input type="checkbox"/> HANGABLE PAN (24-GA. W/ RAILS) | |
| <input type="checkbox"/> NO INS. | <input type="checkbox"/> CROSS-BREAK STIFFENED | <input type="checkbox"/> HANGING HARDWARE (UNISTRUT, CABLE, HARDWARE) | |